N45 TE1F 80kW 80 kW @ 1500 rpm

Stage IIIA

SPECIFICATIONS				
Thermodynamic Cycle	Diesel 4 stroke			
Air Handling	TAA	TAA		
Arrangement	4L			
Bore x Stroke (mm)	104 X 132	104 X 132		
Total Displacement (I)	4.5			
Valves per cylinder (n°)	4	4		
Injection System	ECR			
Speed governor	Electronic	Electronic		
Cooling System	liquid (water - paraflu 50%)			
Direction of Rotation (viewed facing flywheel)	CCW			
Oil specifications	ACEA E3-E5	ACEA E3-E5		
Oil consumption	<0.1% of fuel consuption	<0.1% of fuel consuption		
Fuel specifications	EN 590			
Oil and oil filter maintenance interval for replacement [***] (hours)	600			
Specific fuel consumption at:	1500	1800		
- Stand-By I/h (g/kWh)	-	-		
- 100% load l/h (g/kWh) - 80% load l/h (g/kWh)	212.5 (18.8) 220 (15.7)	-		
- 50% load I/h (g/kWh)	234.5 (11.5)	-		
ATB (without canopy) (°C)	65	-		
Coolant capacity: engine + radiator (I)	~ 18.5			
Coolant capacity: engine only (I)	~ 8.5			
Lube oil total system capacity including pipes, filters etc. (I)	~ 12.8			
Electric system (isolated return)	12			
	1x120			
Starting batteries: recommended capacity (Ah)				
Starting batteries: recommended capacity (Ah) Discharge Current (EN50342) A	500			
, , ,	500 -10			

WEIGHT AND DIMENSIONS	
Dimensions (LxWxH)	1302 X 787 X 1124
Dry Weight	Kg 510

PERFORMANCE				
Ratings	1500 rpm		1800 rpm	
	PRIME	STAND-BY	PRIME	STAND-BY
Rated Power kWm	72.5	80	-	-

PRIME POWER: The prime power is the maximum power available with varying loads for an unlimited number of hours. The average power output during a 24h period of operation must not exceed 80% of the declared prime power between the prescribed maintenance intervals and at standard environmental conditions. A 10% overload is permissible for 1 hour every 12 hours of operation.

STAND-BY POWER: The stand-by power is the maximum power available for a period of 500 hours/year with a mean load factor of 90% of the declared stand-by power. No kind of overloads is permissible for this use.

CONTINUOS POWER: Contact the FPT sales organization.

Legend

Arrangement Air Handling Injection System Emission Standard

L (in line)

V (90° "V" configuration)

TAA (Turbocharged with aftercooler)

V (90° "V" configuration)


TC (Turbocharged)
NA (Naturally Aspirated)

NA (Naturally Aspirated)

M (Mechanical)
ECR (Electronic Common Rail)
EUI (Electronic Unit Injector)

FOR INFORMATION ON THE AVAILABLE RATINGS NOT LISTED IN THIS DOCUMENT PLEASE CONTACT THE FPT INDUSTRIAL SALES NETWORK OR VISIT OUR SITE WWW.FPTINDUSTRIAL.COM



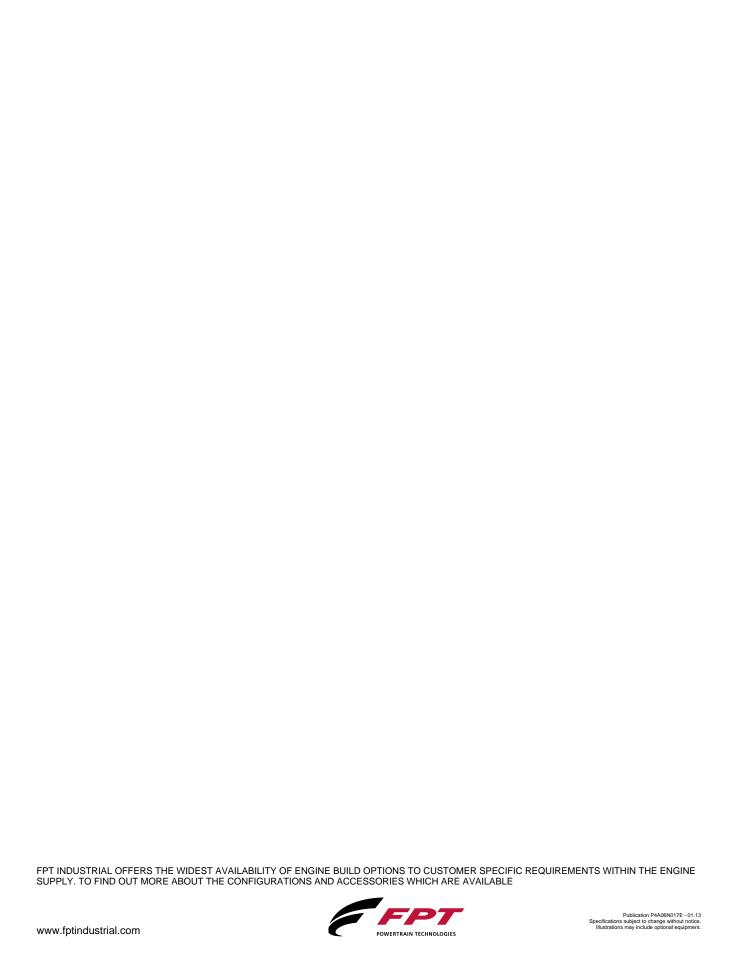

STANDARD CONFIGURATION

- FPT engine N45 TE1F equipped with:

 Mounted radiator incorporating air-to-air charge cooler
- Front radiator fanMounted belt driven pusher fan

- Mounted beit driven pusner fan
 Fan guard
 Mounted air filter with replaceable cartridges
 Fuel filter
 Primary fuel filter/water separator
 Replaceable oil filter
 Electronic engine control unit with wiring loom and sensors
 Interface card
 Front engine mounting broadets

- Front engine mounting brackets
 Flywheel housing SAE3 and flywheel 11"1/2
 Re-directable exhaust gas elbow
- Recirculed oil breather system
- Oil dipstick
- 12 Vdc electrical system
- User's handbook

THE ENGINE IS SUPPLIED WITHOUT LIQUIDS

OPTIONAL EQUIPMENT

- On request the engine can be supplied with:

- Oil drain valve
 120/230 Volt water jacket heater
 WT and OP sensors for gauges
 Low water level sensor

- Low water level sensor
 Turbo and exhaust gas guards
 Exhaust gas flexible joint
 24 Vdc electrical system

